
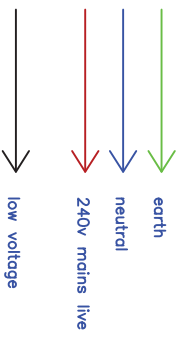


NOTES:
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

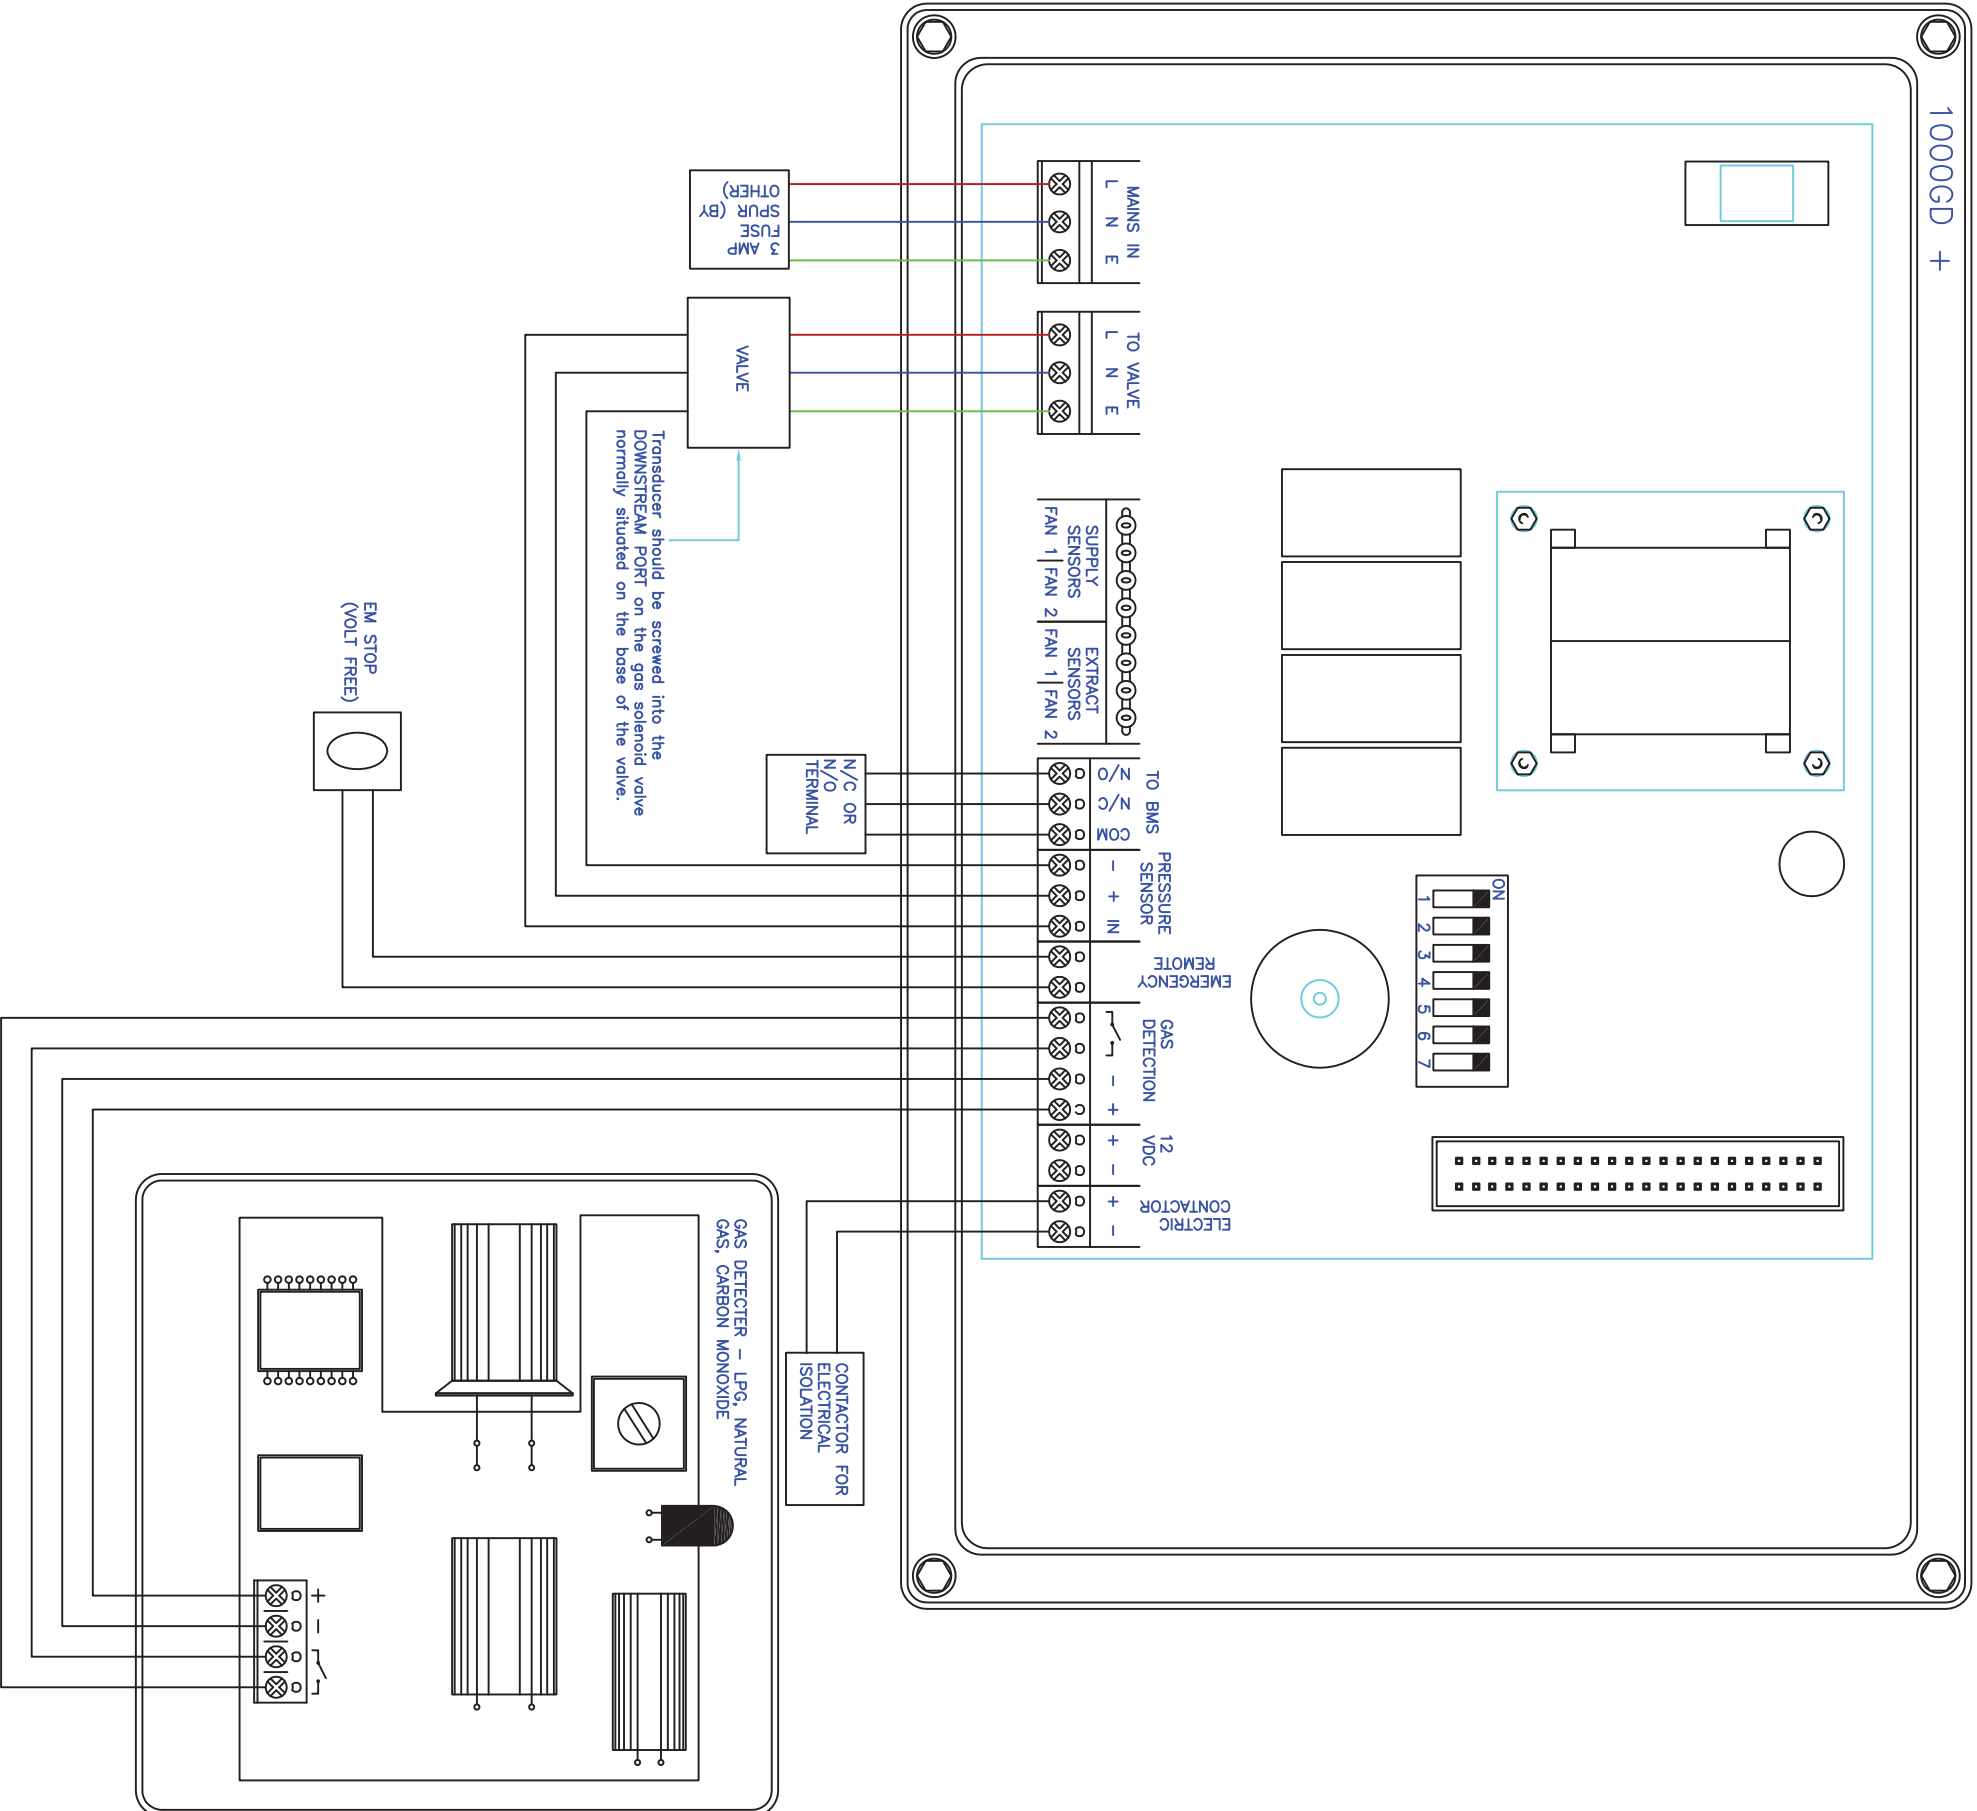

Rev.	-				
Drawn	C	C	C	C	C
Chkd.	C	C	C	C	C
Apprvd.	C	C	C	C	C
Date					
Project: SNS					
Description: PRELIMINARY					

Drawing Title
CT1000GD+
DIAGRAM

www.ssnorthern.com

Unit 2, Debraux Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL
 Tel: 01257 470 863 Fax: 01257 471 997 Email: info@ssnsnorthern.com

Scale (at A1)	Date	Drawn	Rev.
NOT TO SCALE	11/11	SJB	-

Job No. **JOB-DWG-NO**