
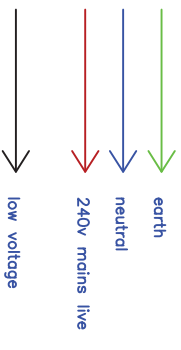


NOTES:
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

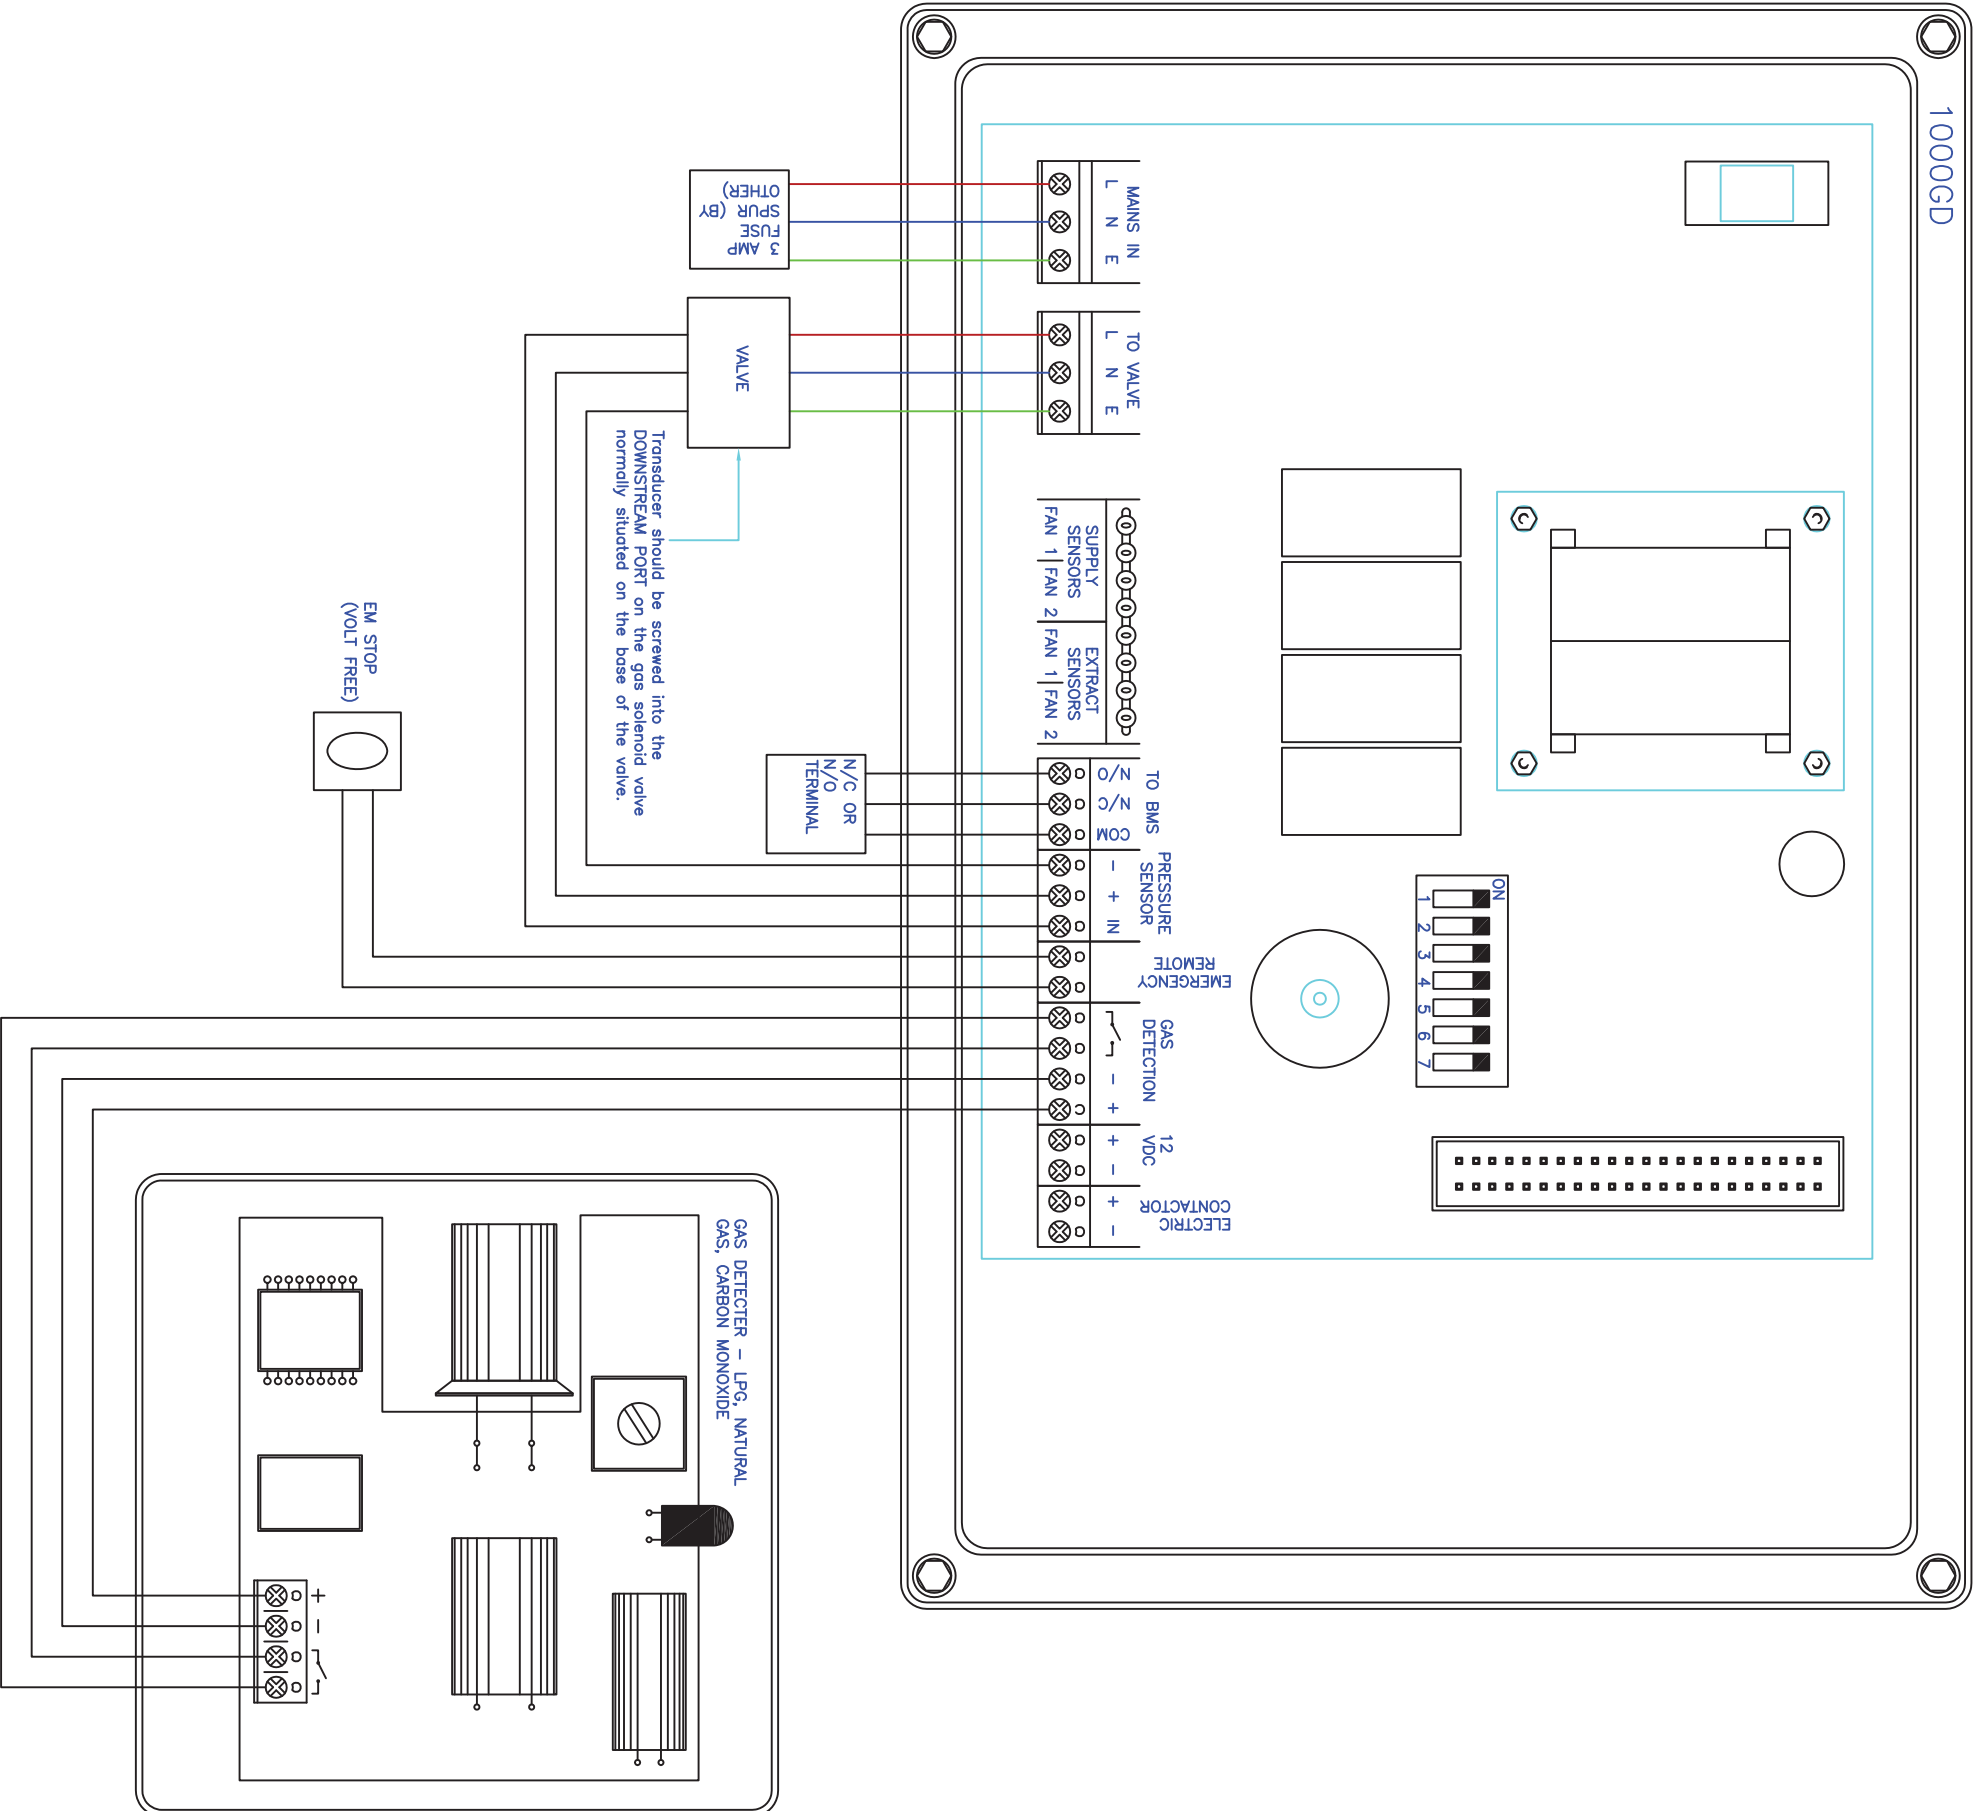

Rev.	-				
Drawn	C	C	C	C	C
Chid.	C	C	C	C	C
Apprvd.	C	C	C	C	C
Date	C	C	C	C	C
Description					
PRELIMINARY					

Project:
SNS
NORTHERN

Drawing Title
1000GD
DIAGRAM

www.ssnorthern.com

Unit 2, Debraux Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL
 Tel: 01257 470 863 Fax: 01257 471 997 Email: info@ssnorthern.com

Scale (at A1)	Date	Drawn	Rev.
NOT TO SCALE	11/11	SLB	-

Job no. **JOB-DWG-NO**