
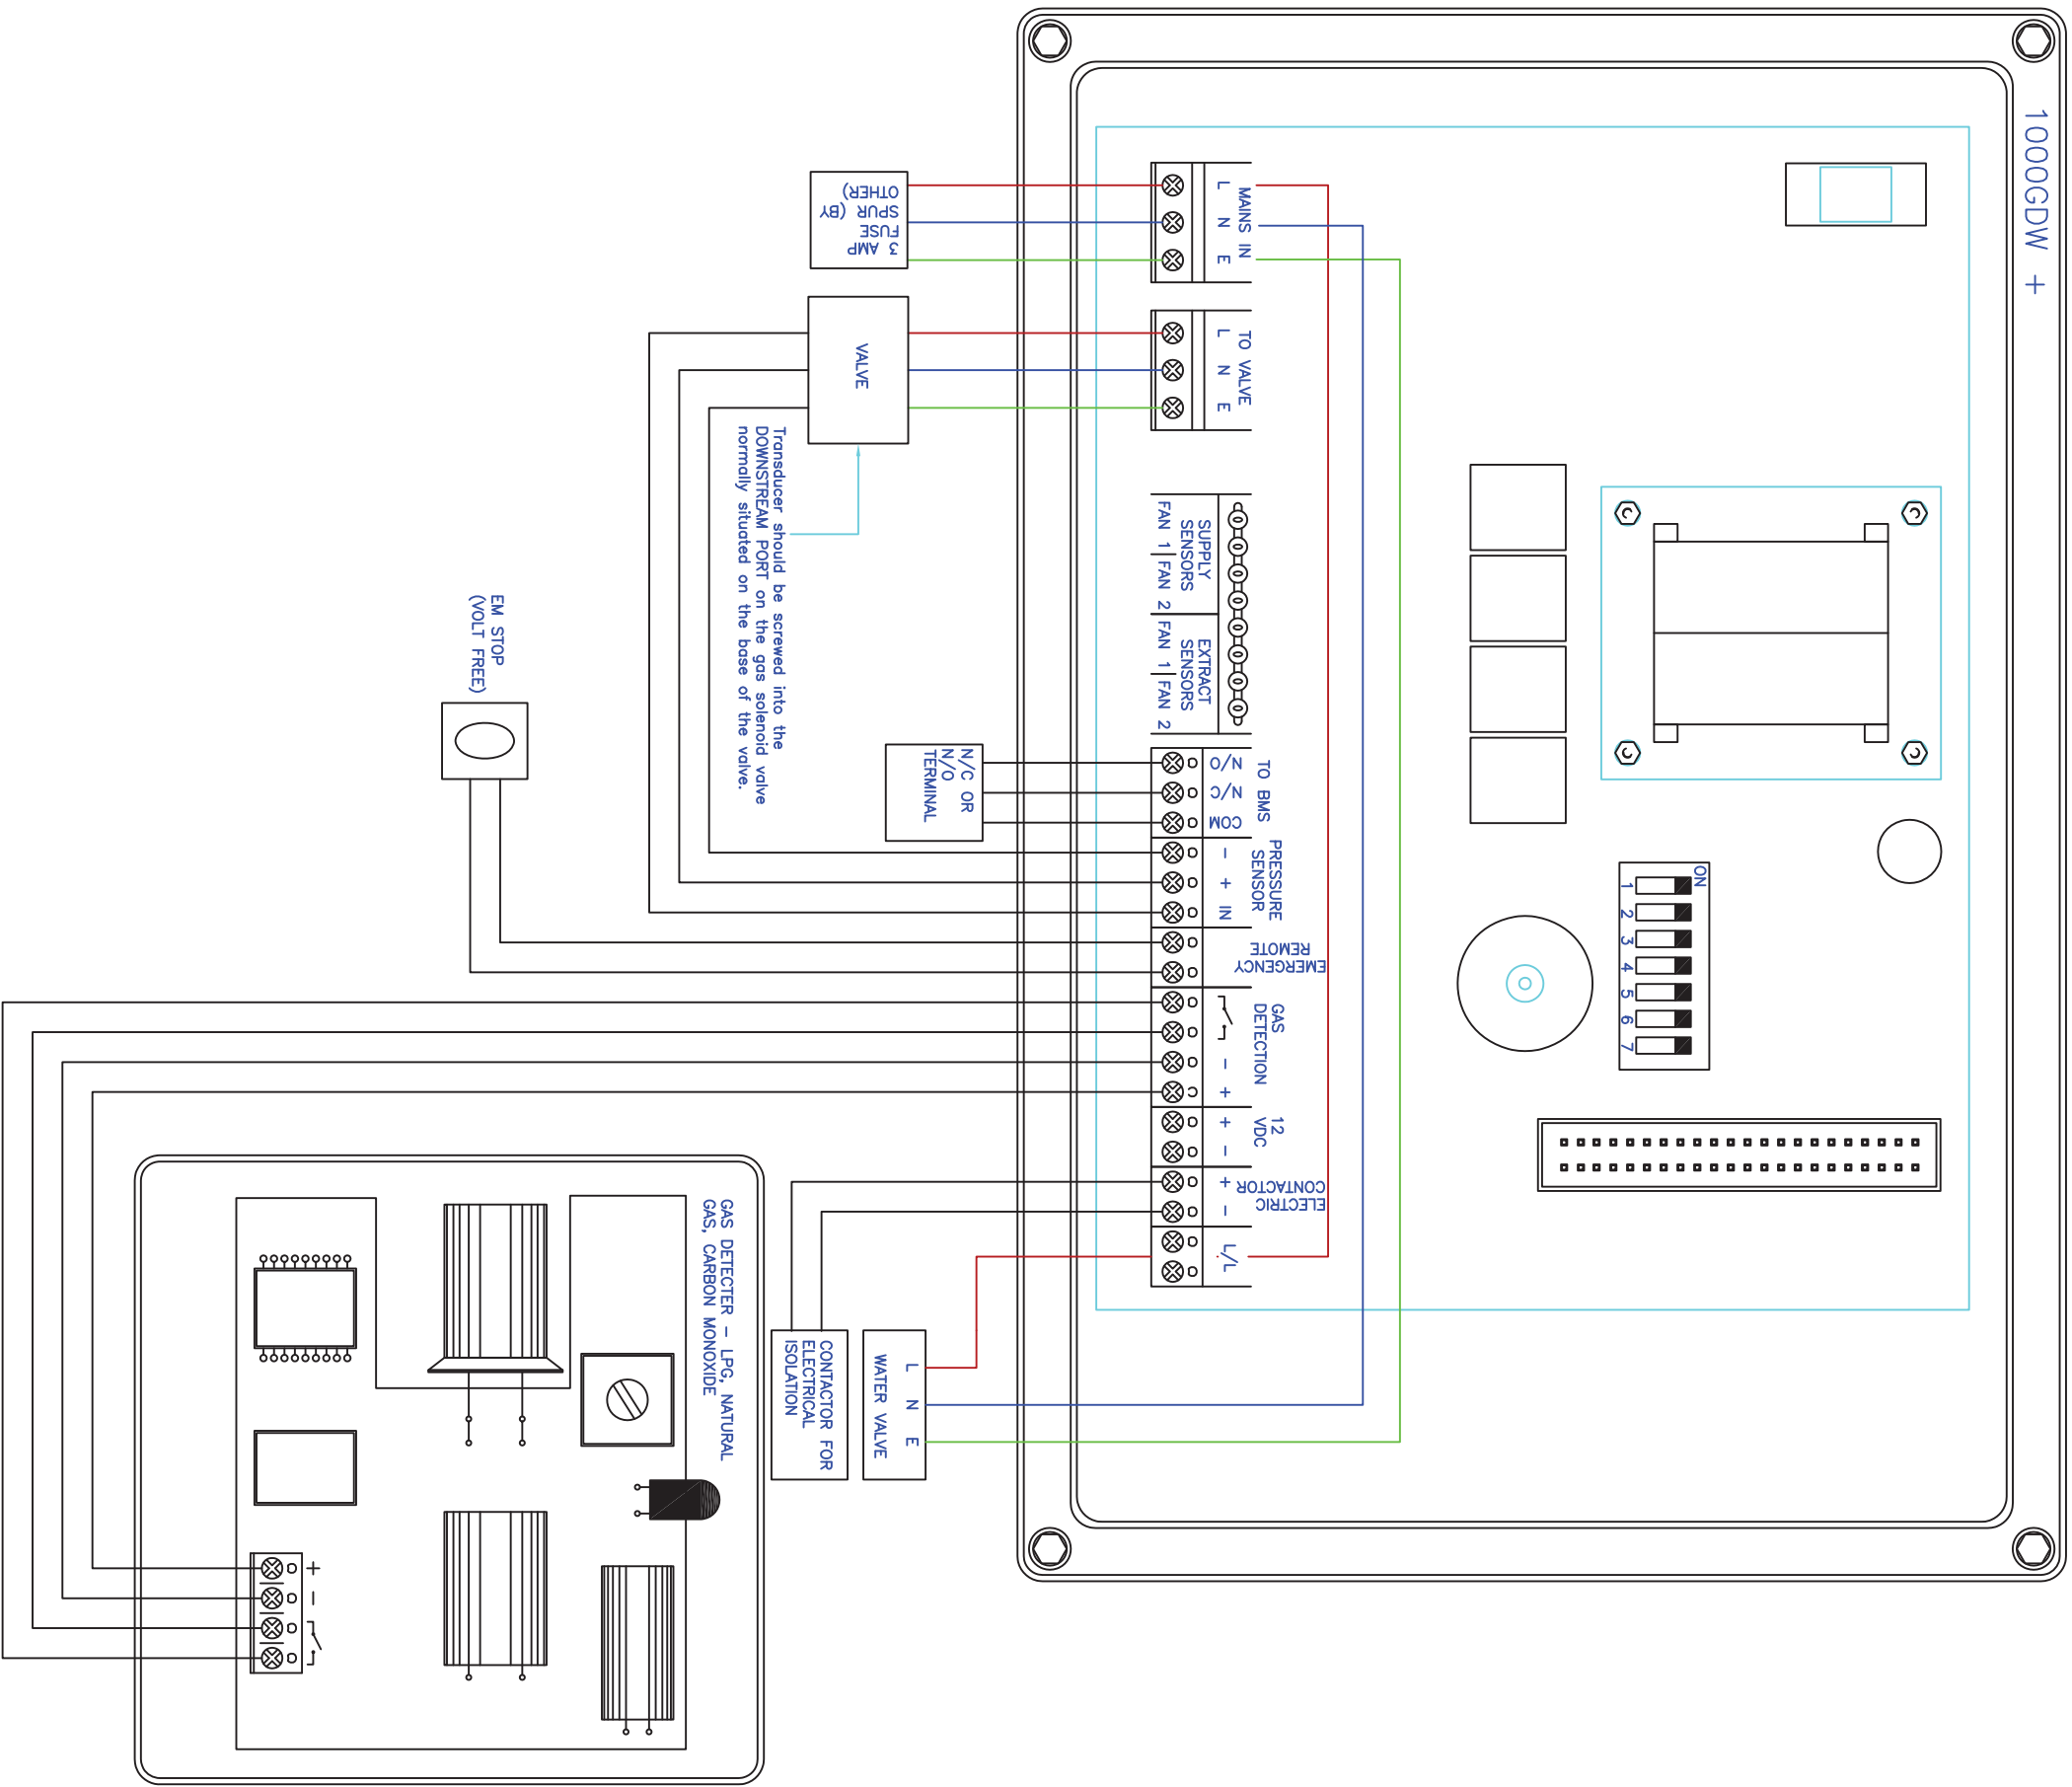


NOTES:
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

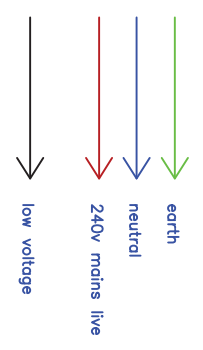

Rev.	Drawn	Chid.	Apprvd.	Date	Description
-	C	C	C	C	PRELIMINARY

Project: SNS
 NORTHERN

Drawing Title:
 1000GDW+
 DIAGRAM

SS&S
 NORTHERN
 www.snsnorthern.com

Unit 2, Debraux Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL
 Tel: 01257 470 863 Fax: 01257 471 997 Email: info@snsnorthern.com

Scale (at A1)	Date	Drawn	Rev.
NOT TO SCALE	11/11	SJB	-

Job no. JOB-DWG-NO