



NOTES:  
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

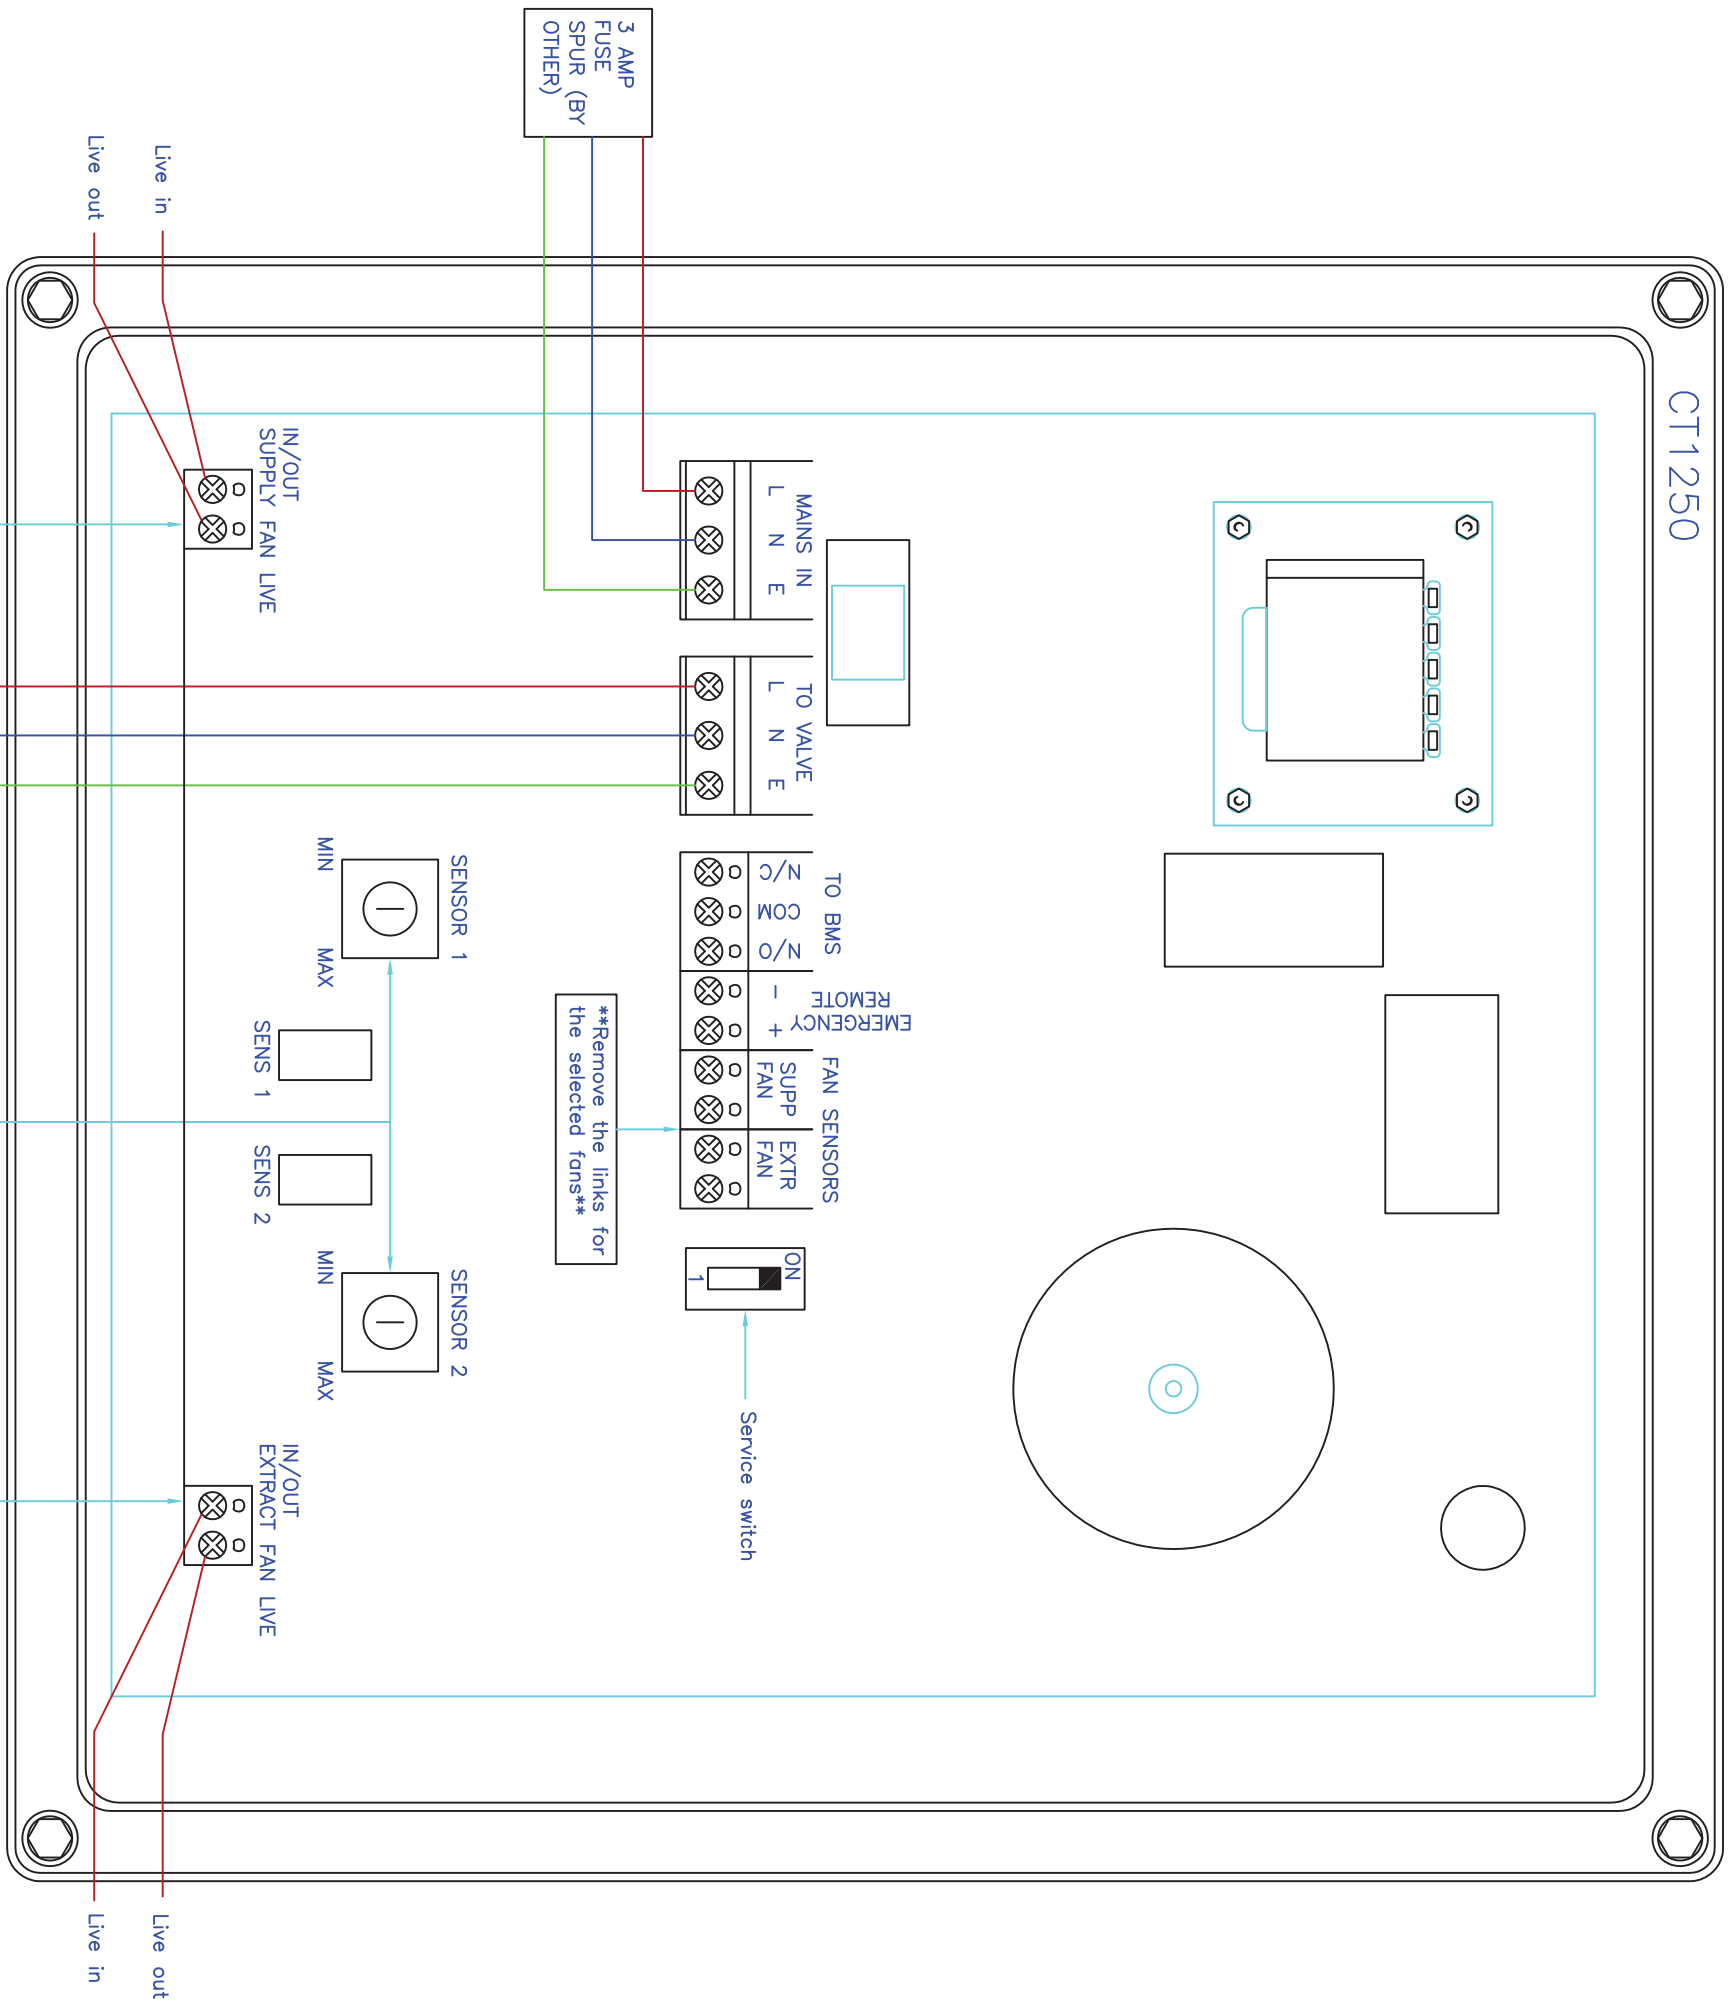

CT1250

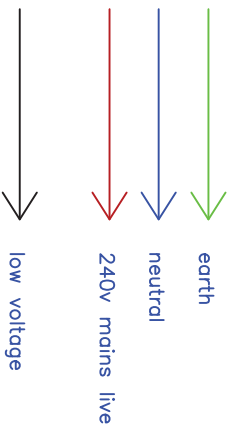

Interrupt the live feed from the Supply fan controller to the extract Fan

\*\*Set the fan speed to minimum desired speed and slowly turn the blue screw head clockwise until the green LED is illuminated\*\*

Interrupt the live feed from the Extract fan controller to the extract Fan

\*\*Remove the links for the selected fans\*\*


  
 www.ssnorthern.com

Unit 2, Debenhams Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL  
 Tel: 01257 470 863 Fax: 01257 471 997 Email: info@ssnorthern.com

Scale (at A1)	Date	Drawn	Rev.
NOT TO SCALE	11/11	SLB	-

Job no. **JOB-DWG-NO**

Drawing Title	CT1250 DIAGRAM
Project	SNS NORTHERN
Rev.	1 - PRELIMINARY
Drawn	C
Chkd.	C
Apprvd.	C
Date	C
Description	