
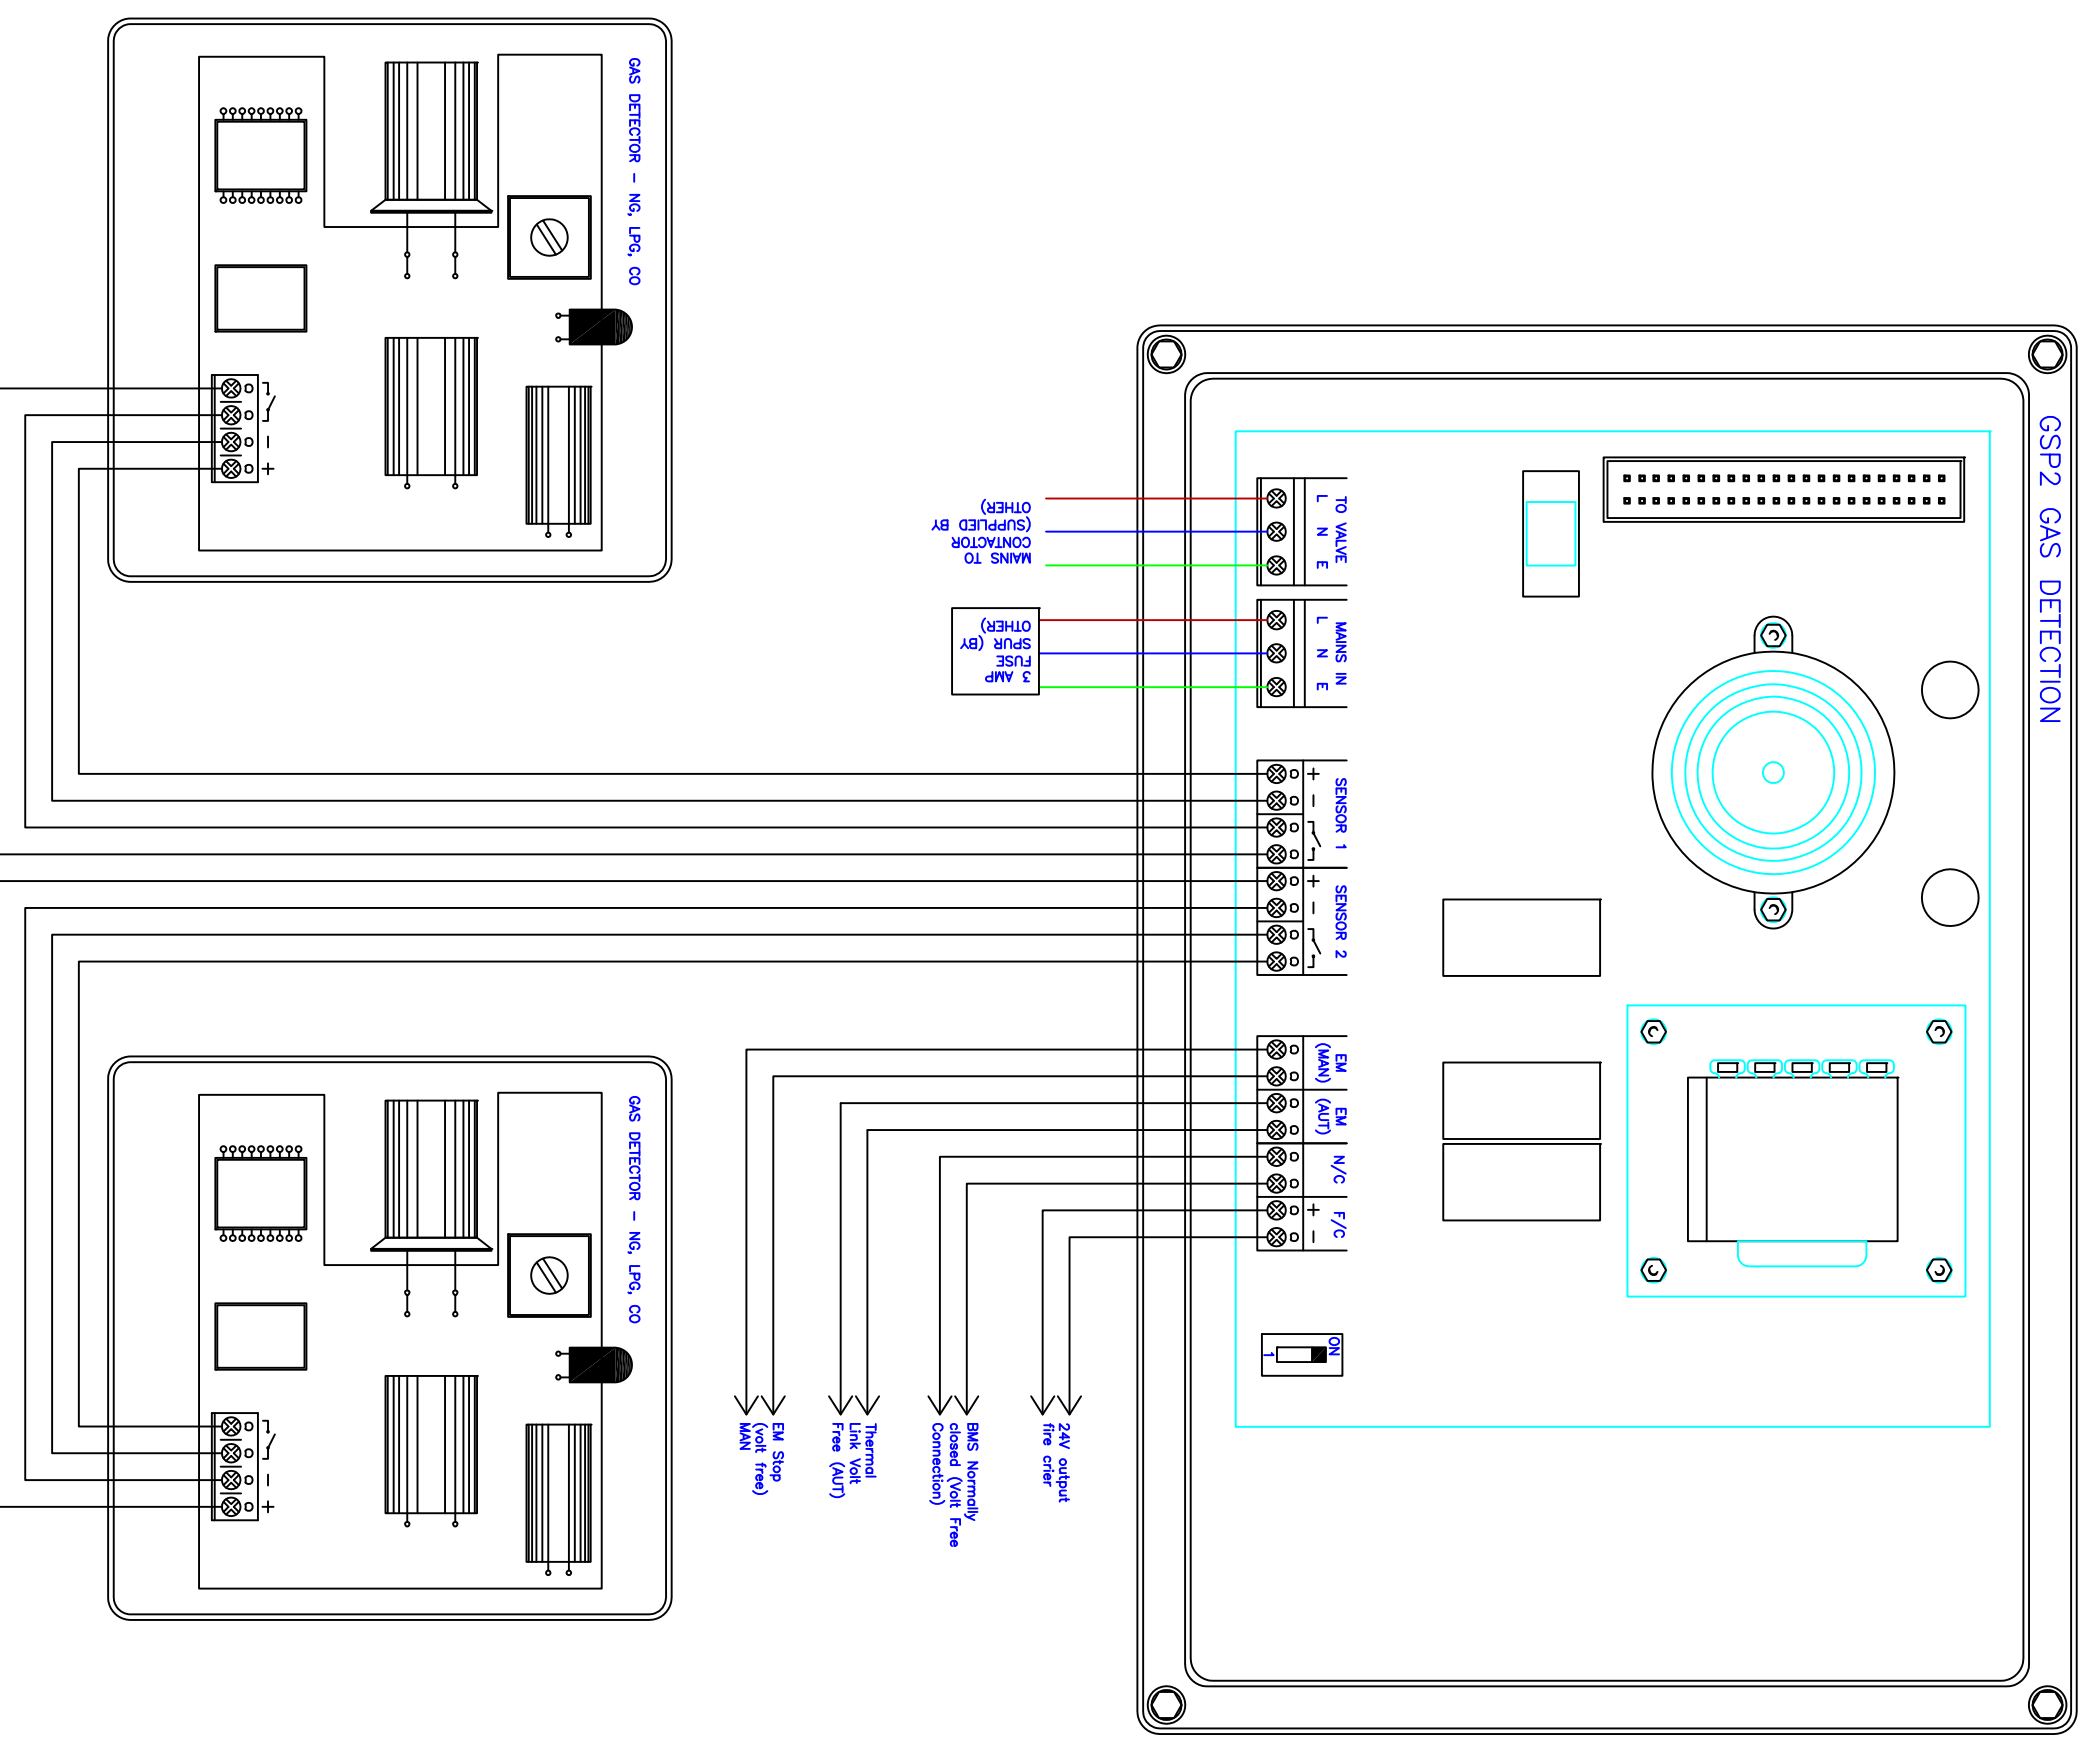


NOTES:  
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

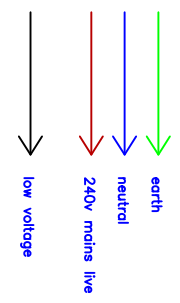

<a href="http://www.ssnorthern.com">www.ssnorthern.com</a>	
<small>Unit 2, DeLoraine Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL Tel: 01257 470 863 Fax: 01257 471 907 Email: info@ssnorthern.com</small>	
<b>Scale</b> (at A1) NOT TO SCALE	<b>Date</b> 11/11
<b>Drawn</b> SLB	<b>Rev.</b> -
<b>Proj.</b> SNS NORTHERN	<b>Rev.</b> - <b>Drawn</b> C <b>Child</b> C <b>Apprvd</b> C <b>Date</b> C
<b>Drawing Title</b> GSP2 DIAGRAM	<b>Description</b> PRELIMINARY
<b>Dwg. no.</b> JOB-DWG-NO	<b>Rev. no.</b> -