
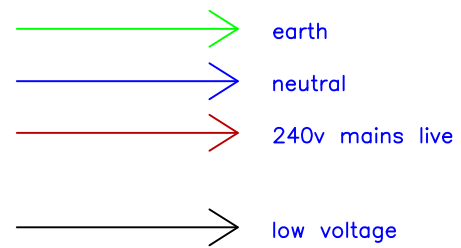


NOTES:
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

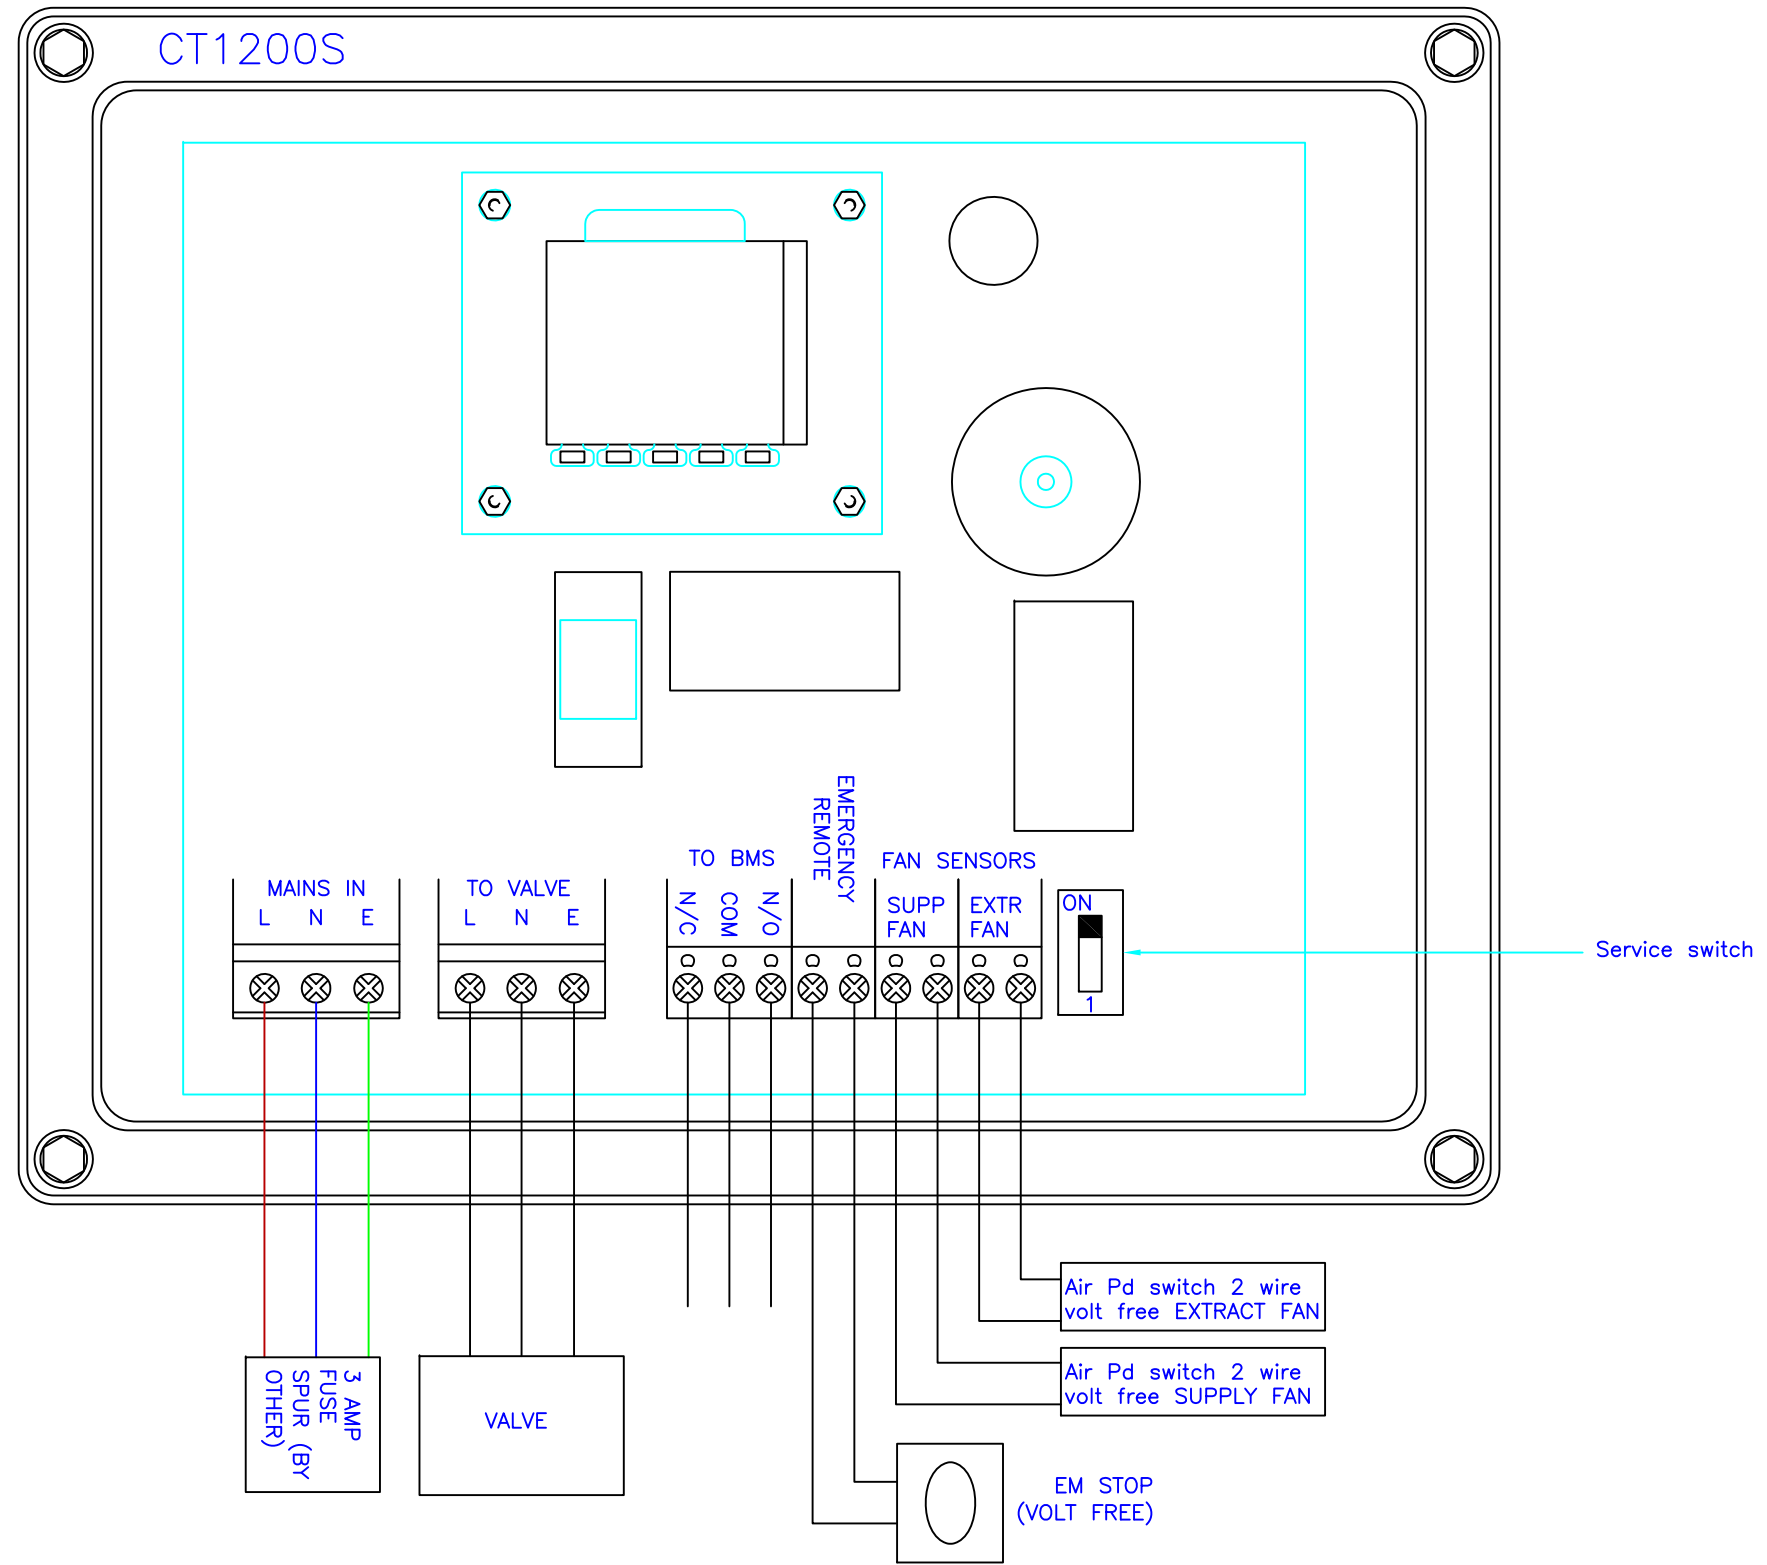

Rev.	?	?	?	?	?	?	PRELIMINARY
Drawn	?	?	?	?	?	?	
Checkd.	?	?	?	?	?	?	
Approved	?	?	?	?	?	?	
Date	?	?	?	?	?	?	
Description							

Project		SNS NORTHERN
Drawing Title		CT1200S DIAGRAM

Unit 2, Dickinsons Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL
Tel: 01257 470 983 Fax: 01257 471 937 Email: info@snsnorthern.com

Scale (at A1)	Date	Drawn
NOT TO SCALE	11/11	SJB
Dwg. no.	Rev.	
JOB-DWG-NO	-	