


3 AMP FUSE SPUR (BY OTHER)

Remove the links for the selected fans

Interrupt the live feed from the Supply fan controller to the extract Fan

Set the fan speed to minimum desired speed and slowly turn the blue screw head clockwise until the green LED is illuminated

Interrupt the live feed from the Extract fan controller to the extract Fan

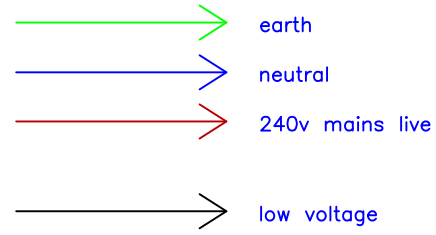

NOTES:
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

Rev.	?	?	?	?	?	PRELIMINARY
Drawn	?	?	?	?	?	
Checked	?	?	?	?	?	
Approved	?	?	?	?	?	
Date	?	?	?	?	?	
Description						

Project
SNS
NORTHERN

Drawing Title
CT1250
DIAGRAM



Unit 2, Dickinsons Industrial Estate, Moss Lane, Coppull, Chorley, PR7 5AL
Tel: 01257 470 983, Fax: 01257 471 937 Email: info@snsnorthern.com

Scale (at A1)	Date	Drawn
NOT TO SCALE	11/11	SJB

Dwg. no.	Rev.
JOB-DWG-NO	-