



NOTES:  
NO VOLTAGE ABOVE 24V SHOULD BE PUT INTO THE NC TERMINALS

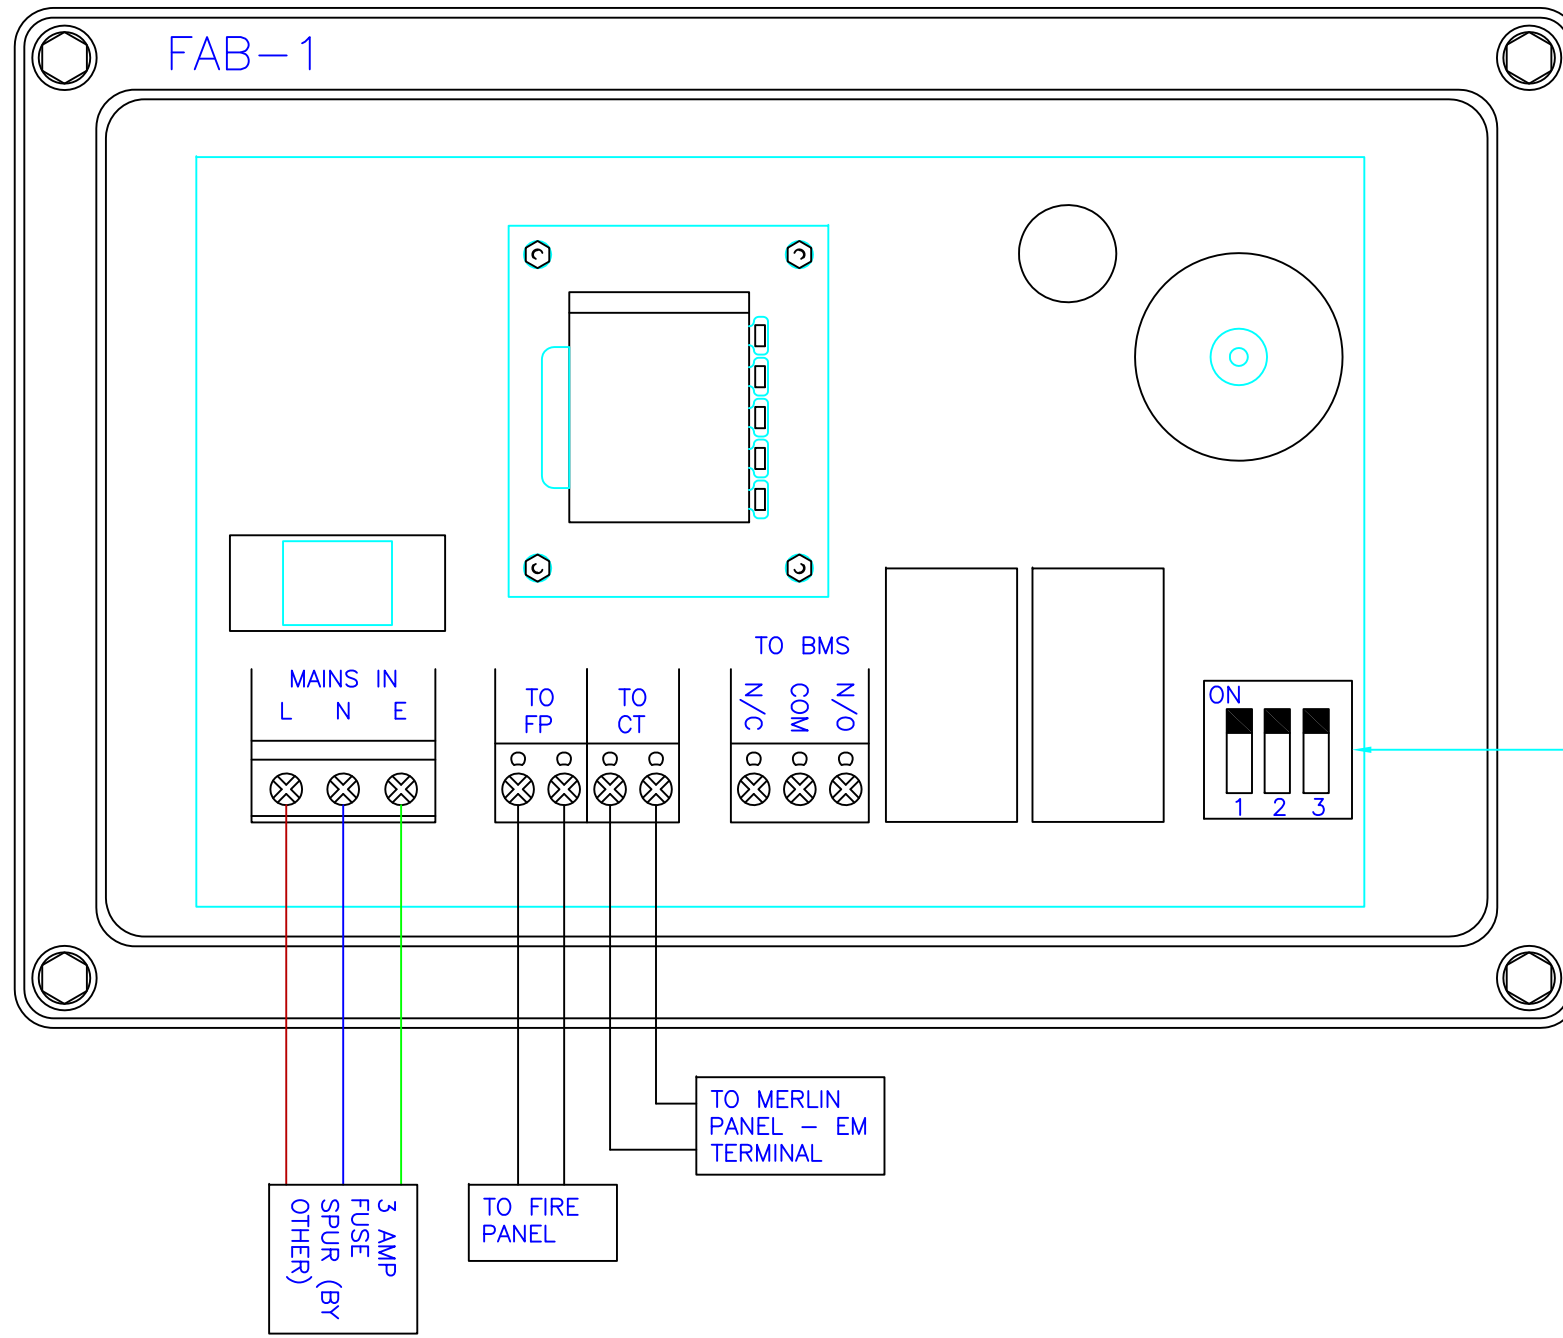

switches for by-pass time adjustments

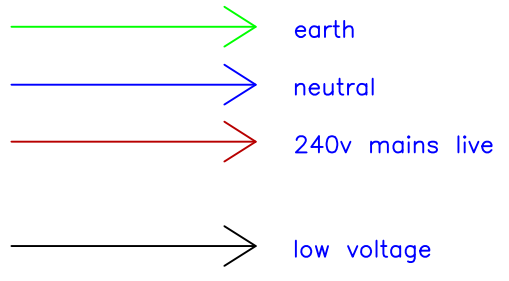

Rev.	Drawn	Chkd.	Apprvd.	Date	Description
-	?	?	?	?	PRELIMINARY

Project  
**SNS NORTHERN**

Drawing Title  
**FAB-1 WIRING DIAGRAM**



Scale (at A1)	Date	Drawn
NOT TO SCALE	11/11	SJB

Dwg. no.	Rev.
JOB-DWG-NO	-